


SCHEDULE OF ITEMS	
ITEM NO.	DESCRIPTION
1 & 2	REFER TO DRAWING 17
3	ISOLATING VALVE. IF BUTTERFLY VALVE TO BE GEAR SHUT TYPE (RESILIENT SEATED)
4	SINGLE CHECK DETECTOR ASSEMBLY TESTABLE. VALVE TO CONFORM TO AS/NZS2845
5	25mm BYPASS METER SUPPLIED BY WATER CORPORATION.
6	25mm DUAL SPRING LOADED CHECK VALVE
7	LOCKABLE BALL VALVES WITH A003 KEYED LOCKS
8	TEST PORT
9	WATER METER FOR GENERAL SERVICE
10	APPROPRIATE BFD
SEE GENERAL NOTES FOR FURTHER INFORMATION	

STANDARD LEGEND	
X	V Valve
O	M Meter
□	D.B. Dirt Box
—	S.P. Straight Piece
┌┐	T.F. Testing Ferrule
▭	L.S. Line Strainer
∑	B.P.D. Backflow Prevention Device (Testable or Non-Testable)
Z	S.C.V.T Single Check Valve Testable
∑	Single Check Detector Assembly Testable S.C.D.A.T.

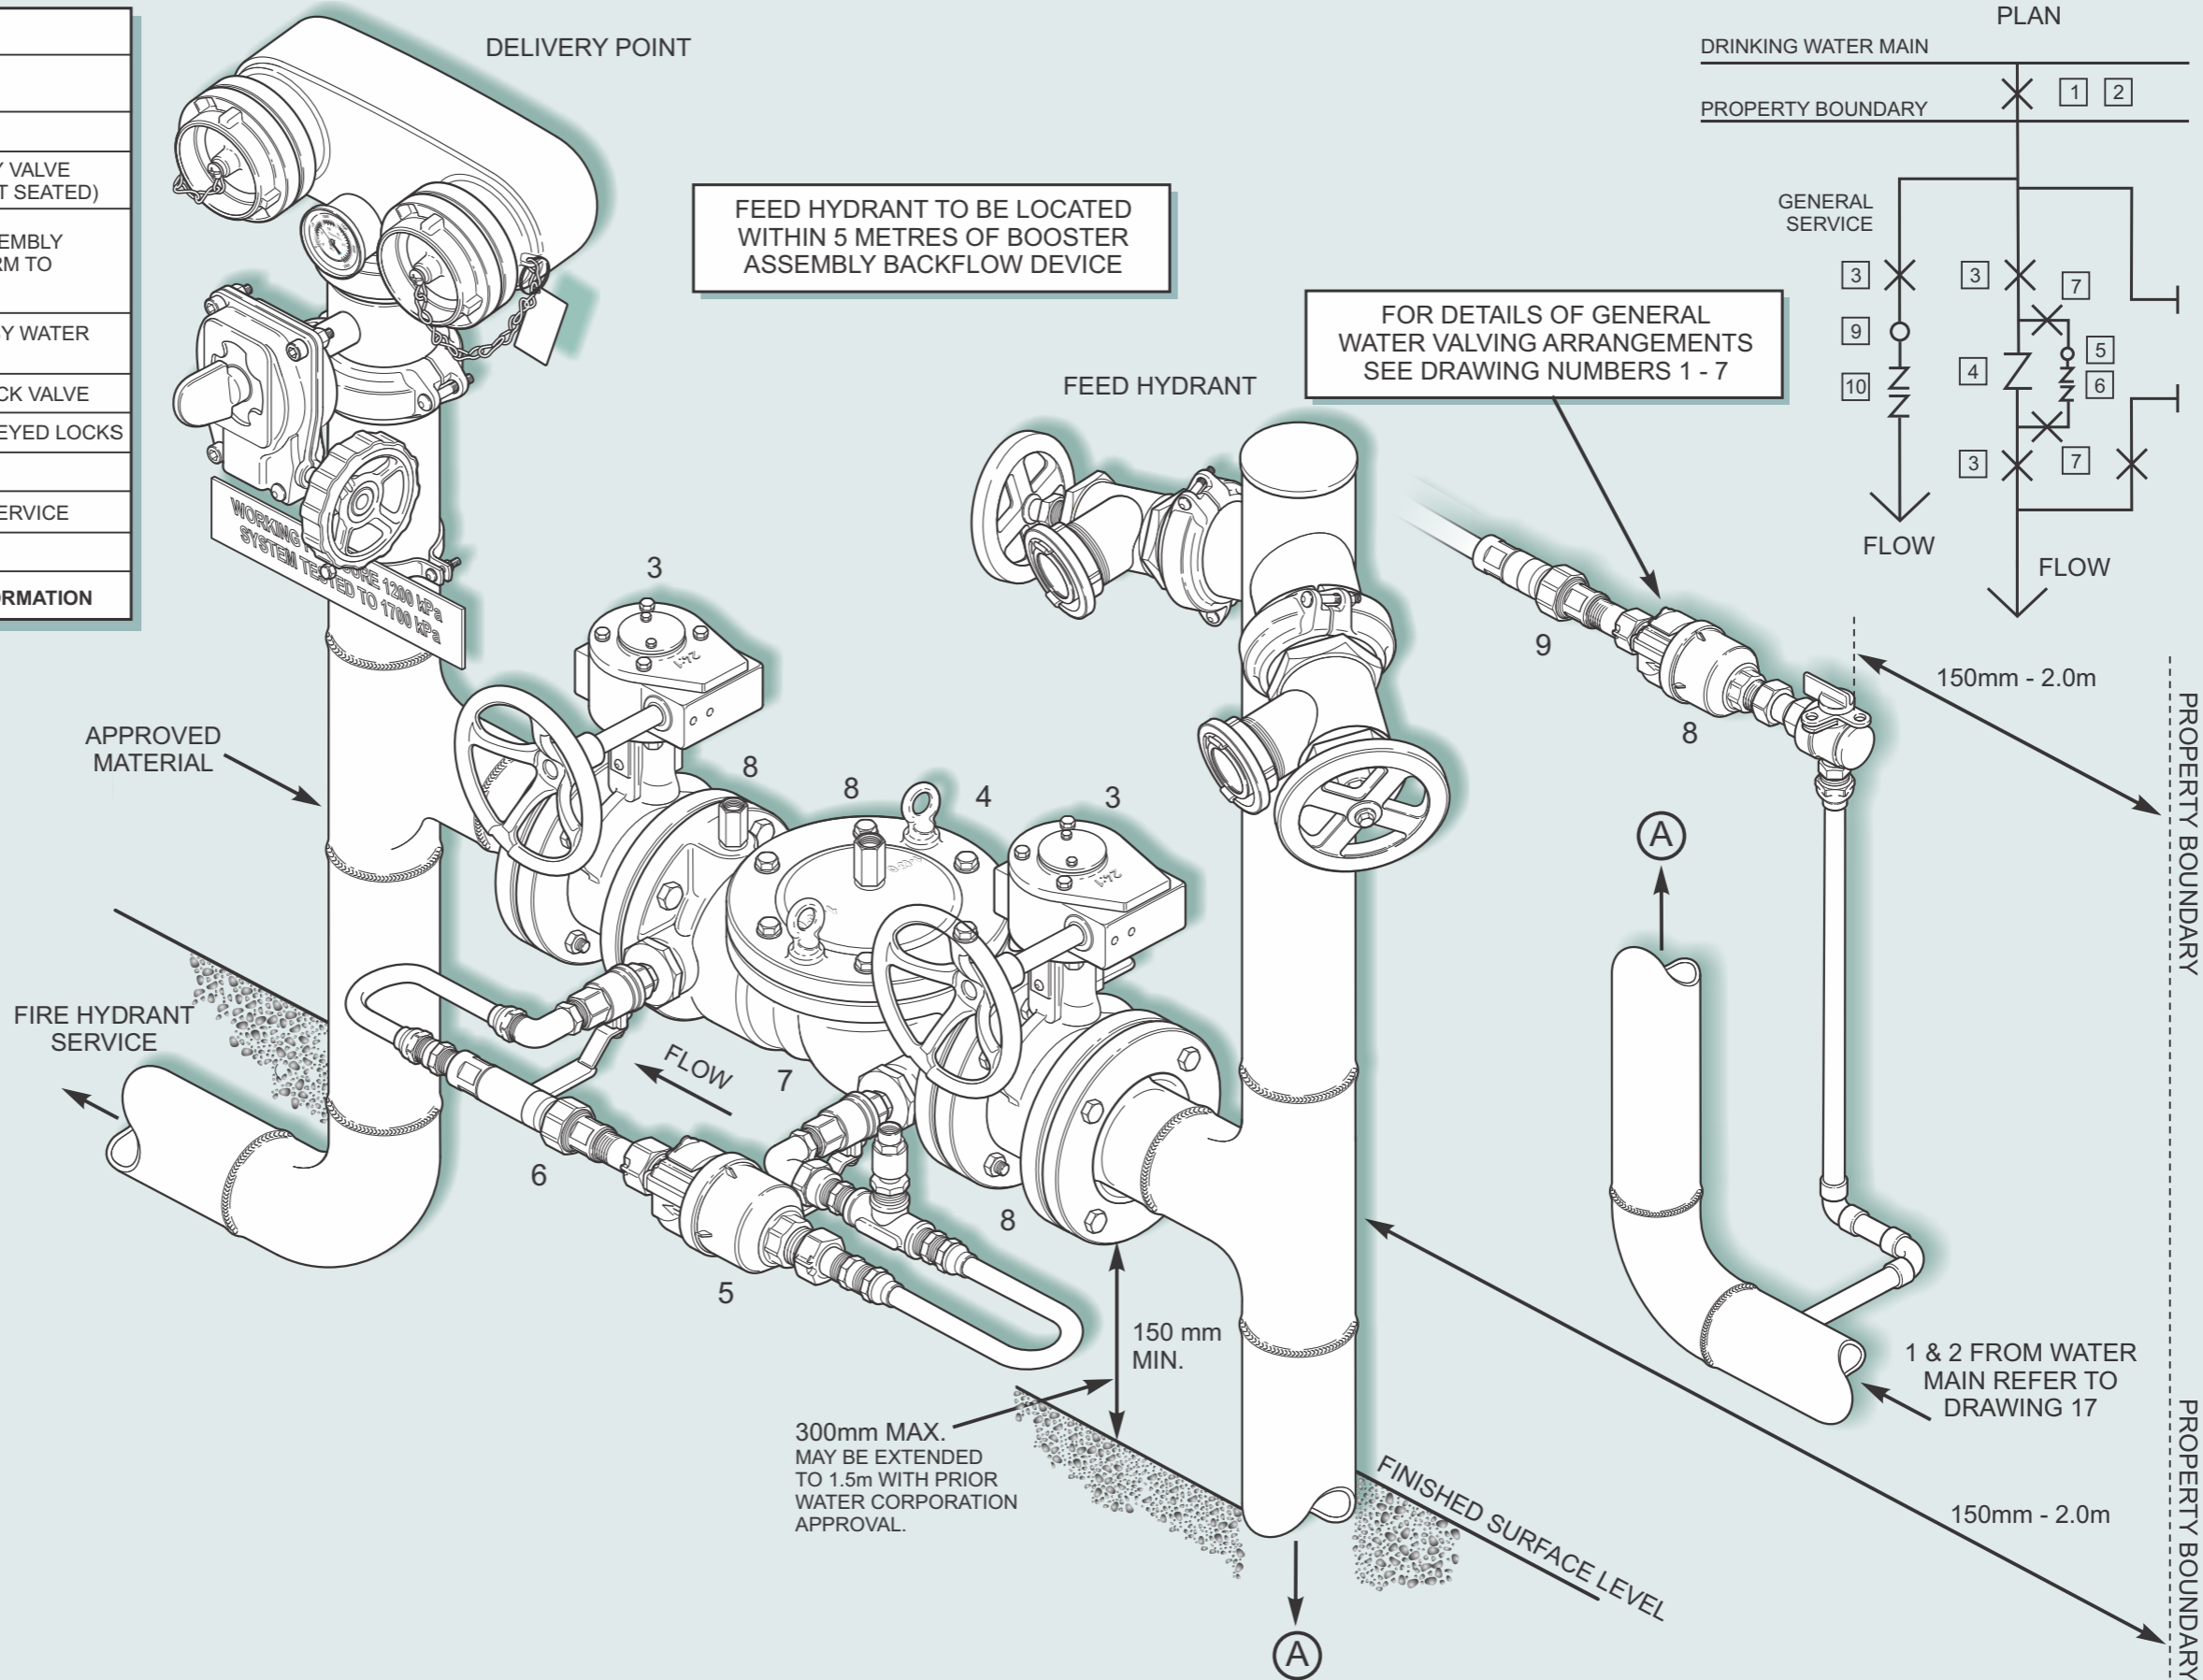

DRAWING NUMBER:

14

SCALE:

NOT TO SCALE

DATE:

JULY 2017

BOOSTER CONNECTION AROUND METER  
FIRE HYDRANT SUPPLY  
TYPICAL ARRANGEMENT

