



CWW PROJECT NUMBER:	MELWAY REFERENCE:	AUTHORISED:	CITY WEST WATER AUTHORIZED TO PROCEED:	REV.	DESCRIPTION	DATE	APP'D
DESIGNED: Z. LANCIANA DATE: 29/05/2009				0	ISSUED AS STANDARD DRAWING	08/09/10	
CHECKED:							
DATE: / /	DATE: / /	DATE: / /	DATE: / /				

GREASE INTERCEPTOR

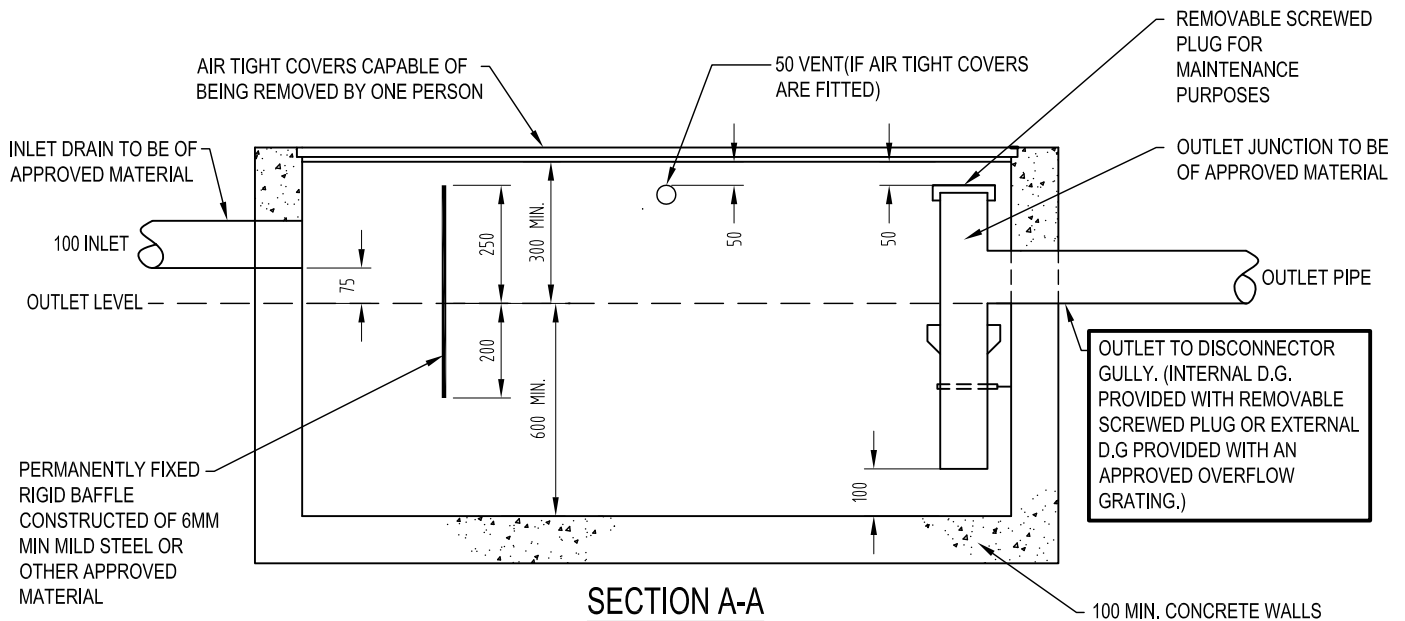

SECTION A-A

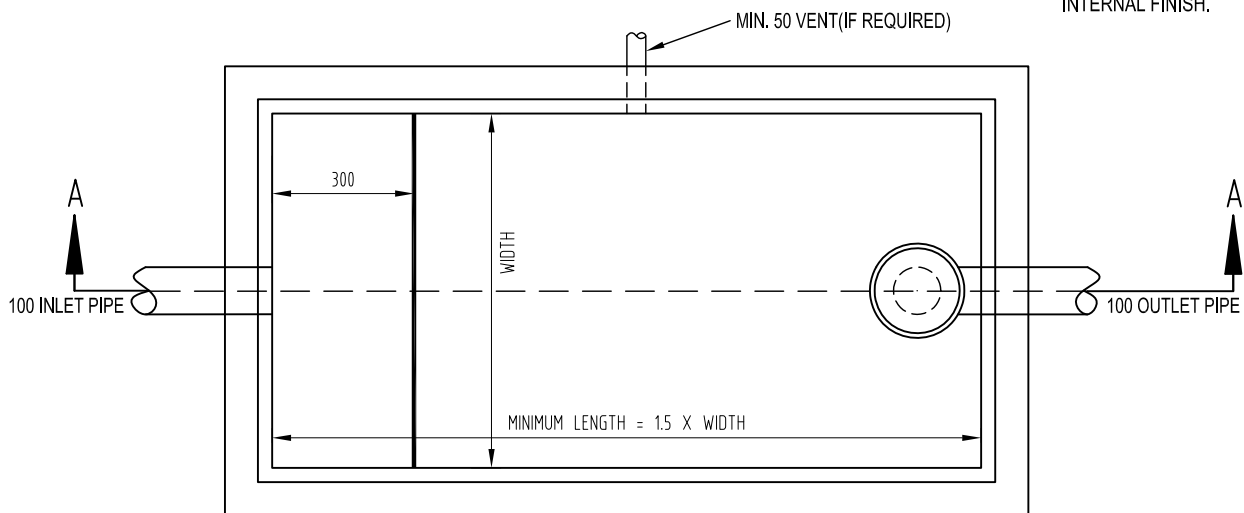

PLAN

(COVERS REMOVED)

NOTE:

1. THE RELEVANT HEALTH AUTHORITY (e.g. COUNCIL) MUST APPROVE THE PROPOSED INTERNAL LOCATION OF THE INTERCEPTOR PRIOR TO ITS INSTALLATION.
2. THE INTERCEPTOR MUST BE CONSTRUCTED, INSTALLED AND CONNECTED IN ACCORDANCE WITH THE RELEVANT PLUMBING REGULATIONS.
3. WHERE NOT SPECIFIED BY CITY WEST WATER, THE CAPACITY BELOW THE OUTLET MUST BE EQUIVALENT TO THE MAXIMUM HOURLY DISCHARGE, PROVIDED THAT THE MINIMUM CAPACITY BELOW THE OUTLET MUST NOT BE LESS THAN 250 LITRES
4. THE CONTENTS OF THE INTERCEPTOR MAY BECOME SLIGHTLY ACIDIC, THEREFORE INTERNAL CONCRETE SURFACE NEED TO BE ACID RESISTANT.
5. WHERE INSTALLED ABOVE GROUND, THE INTERCEPTOR MAY BE CONSTRUCTED USING OTHER APPROVED MATERIALS, SUBJECT TO ADEQUATE STRUCTURAL SUPPORT FOR THE INTERCEPTOR BEING PROVIDED.
6. INTERCEPTORS CONSTRUCTED FROM PVC AND INSTALLED ABOVE GROUND MUST BE PROTECTED FROM DIRECT SUNLIGHT.
7. THE INTERCEPTOR MUST BE INSTALLED AND LOCATED SO AS TO PROVIDE READY ACCESS FOR MAINTENANCE (INCLUDING PUMP OUTS) AND INSPECTION PURPOSES.
8. WHERE THE INTERCEPTOR IS INSTALLED OUTSIDE A BUILDING, AIR TIGHT COVERS ARE ALSO TO BE FITTED, VENTING THE CHAMBER AND PROVIDING A SCREW CAP & 50mm VENT TO THE DISCONNECTOR GULLY.
9. ALL DIMENSIONS ARE IN MILLIMETRES.

THIS DRAWING SUPERSEDES TRADE WASTE DRG. No. 9-1A



CITY WEST WATER LIMITED

TRADE WASTE STANDARD DRAWING

GREASE INTERCEPTOR

(FOR ABOVE OR BELOW GROUND INSTALLATIONS)

SCALE: N.T.S. @ A4

SHEET: 1 OF 1

DRAWING No.:

TW-STD-008 0